Koblingsskjemaer for kontrollbokser for Spabad

g. Balboa BP200G1

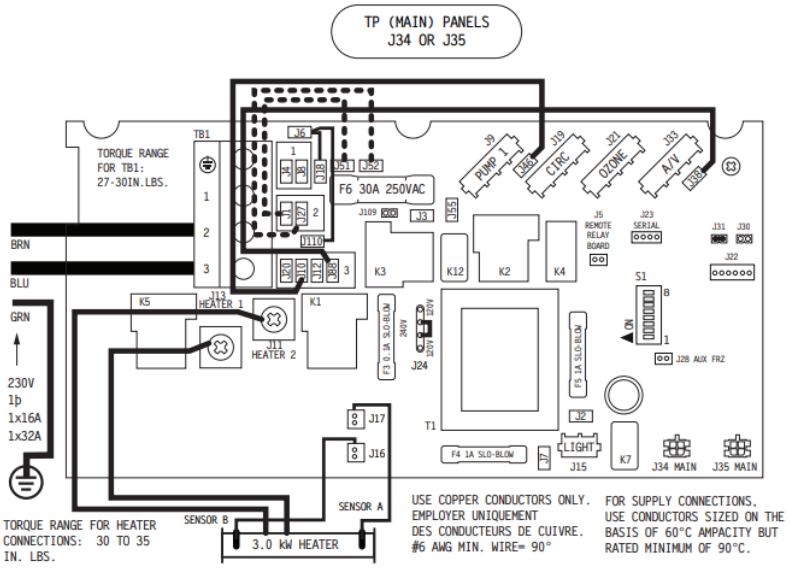

ON POSITION	S1 SWITCH #	OFF POSITION
TBD	8 ▶	TBD
SIMPLIFIED MENUS	7 ▶	STANDARD MENUS
MEMORY RESET*	6 ▶	STORE SETTINGS*
SPECIAL AMPERAGE RULE ON	5 ▶	SPECIAL AMPERAGE RULE OFF
5 MIN HTR COOLDOWN (GAS)	4 ▶	1 MIN HTR COOLDOWN (ELEC)
ADD 2 HS PUMPS WITH HEAT	3 ▶	DON'T ADD 2 HS PUMPS W/HTR
ADD 1 HS PUMP WITH HEAT	2 ▶	DON'T ADD 1 HS PUMP W/HTR
TEST MODE ON	1 ▶	TEST MODE OFF

230V
1þ
1x16A

*SWITCH # 6 SHOULD BE SET TO OFF UPON FINAL INSTALLATION.
ALL UNUSED SWITCHES SHOULD BE OFF